


PROTECTED FIRE ZONE: Shown in green.

NOTE.—For description of fire protection, etc., see other side.  
Elevations range from 0 to 40 feet above mean sea level.  
Practically all mains cement pipe  
Water mains 8 inches and larger in diameter  
Water mains 6 inches in diameter  
Water mains 4 inches in diameter

- Fire hydrants shown thus:
- Gate valves shown thus:
- Fire house shown thus:
- Fire apparatus designated by symbols thus:
  - Hose wagon;
  - Chemical engine;
  - Hose reel;
  - Hand drawn apparatus;
  - Automobile apparatus;
  - Chemical tank or tanks on above.

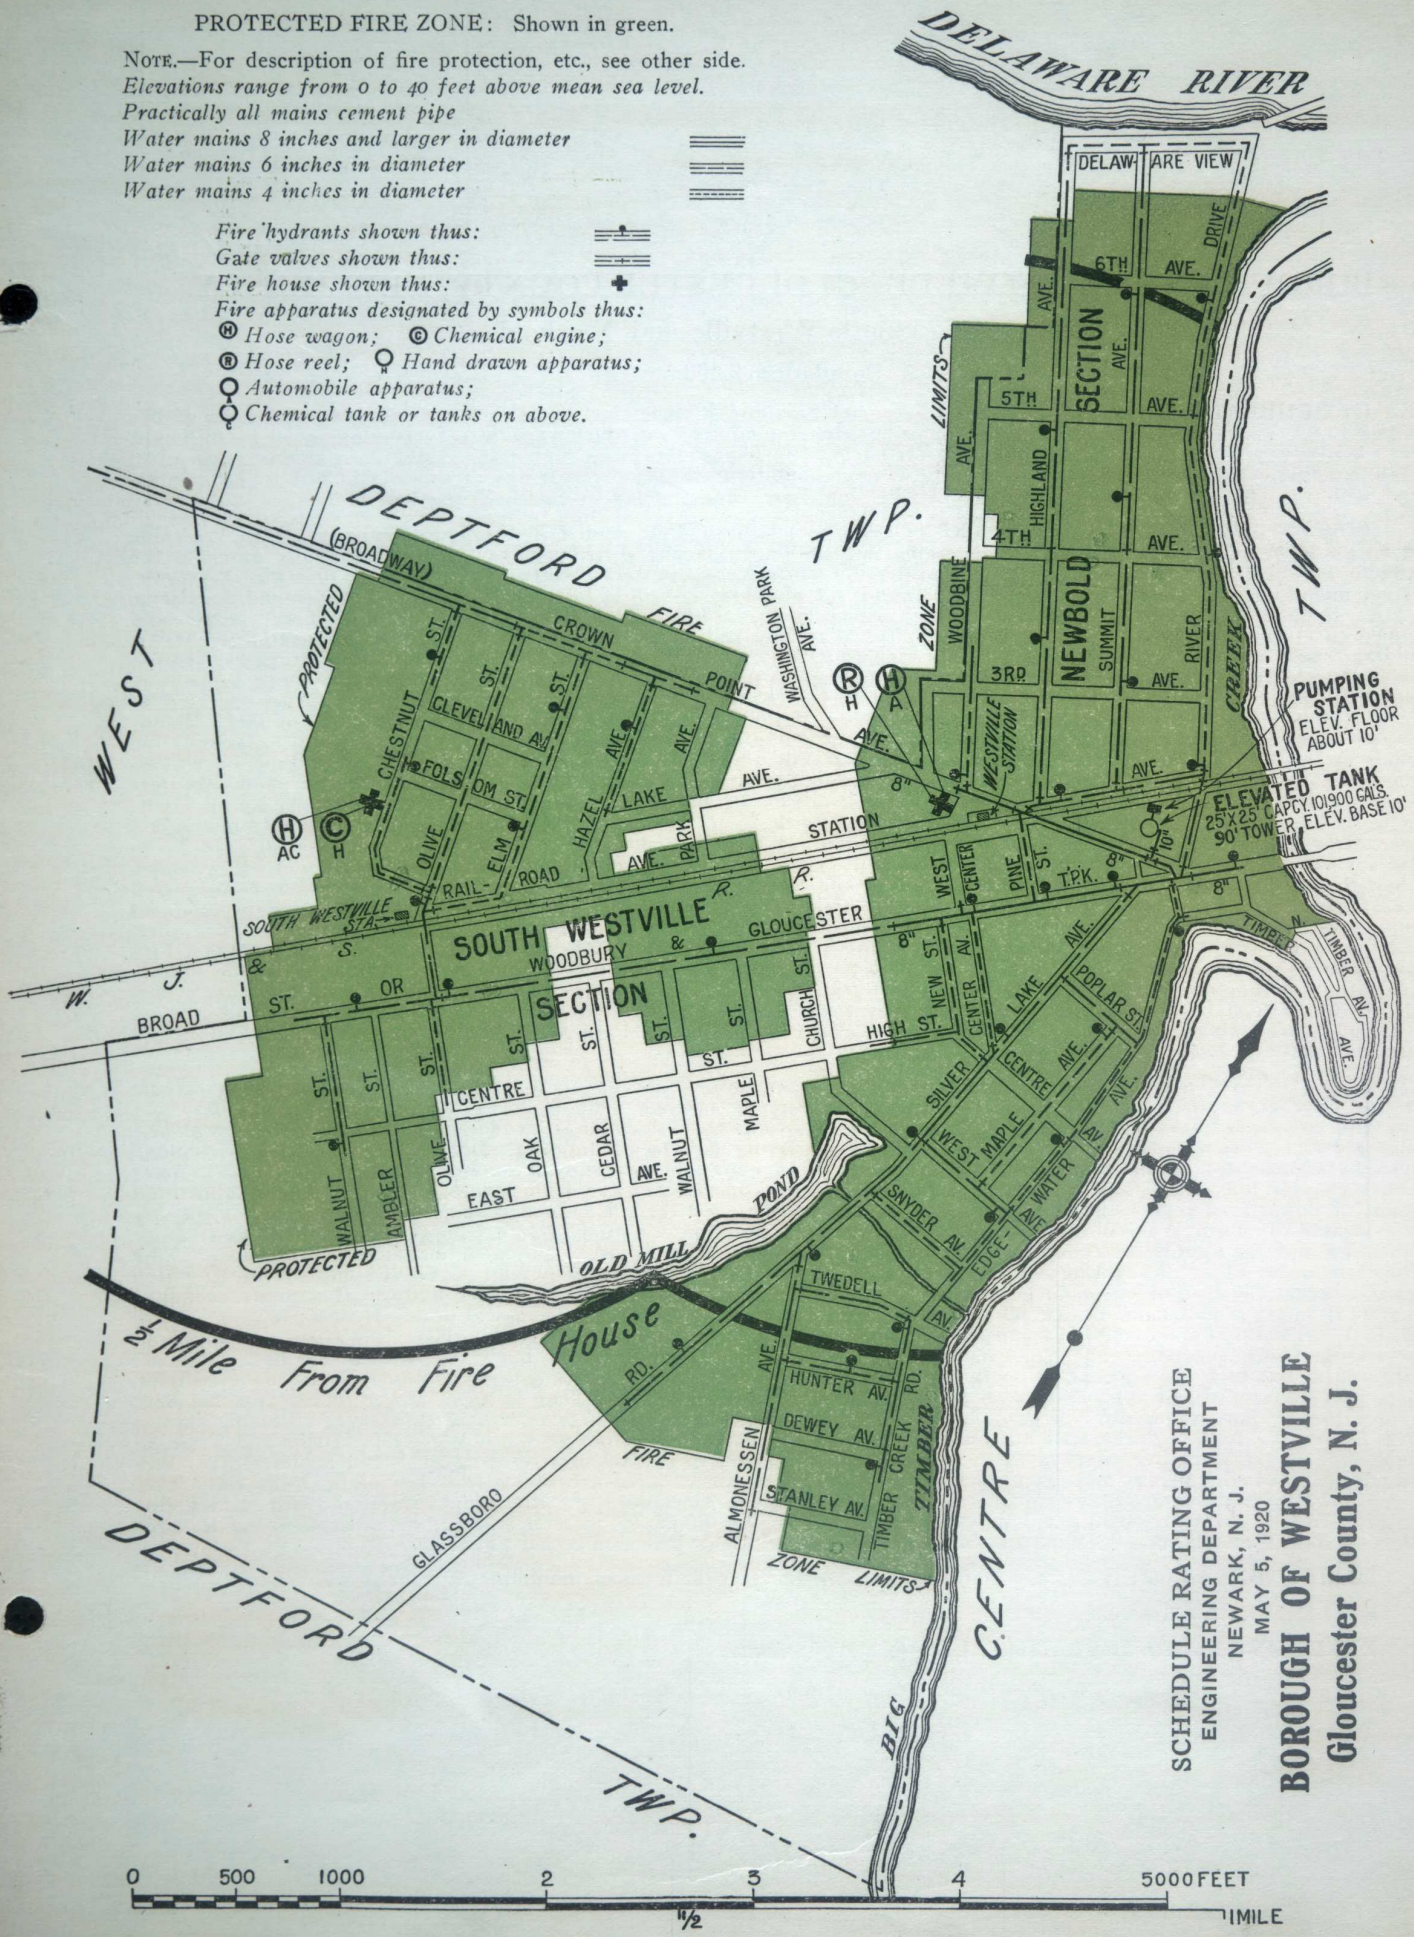

MP/3813/650/221/1920A

SCHEDULE RATING OFFICE  
ENGINEERING DEPARTMENT  
NEWARK, N. J.  
MAY 5, 1920

**BOROUGH OF WESTVILLE**  
Gloucester County, N. J.