


Superseding Map No. 210 of December 30, 1939. Please destroy old issue.

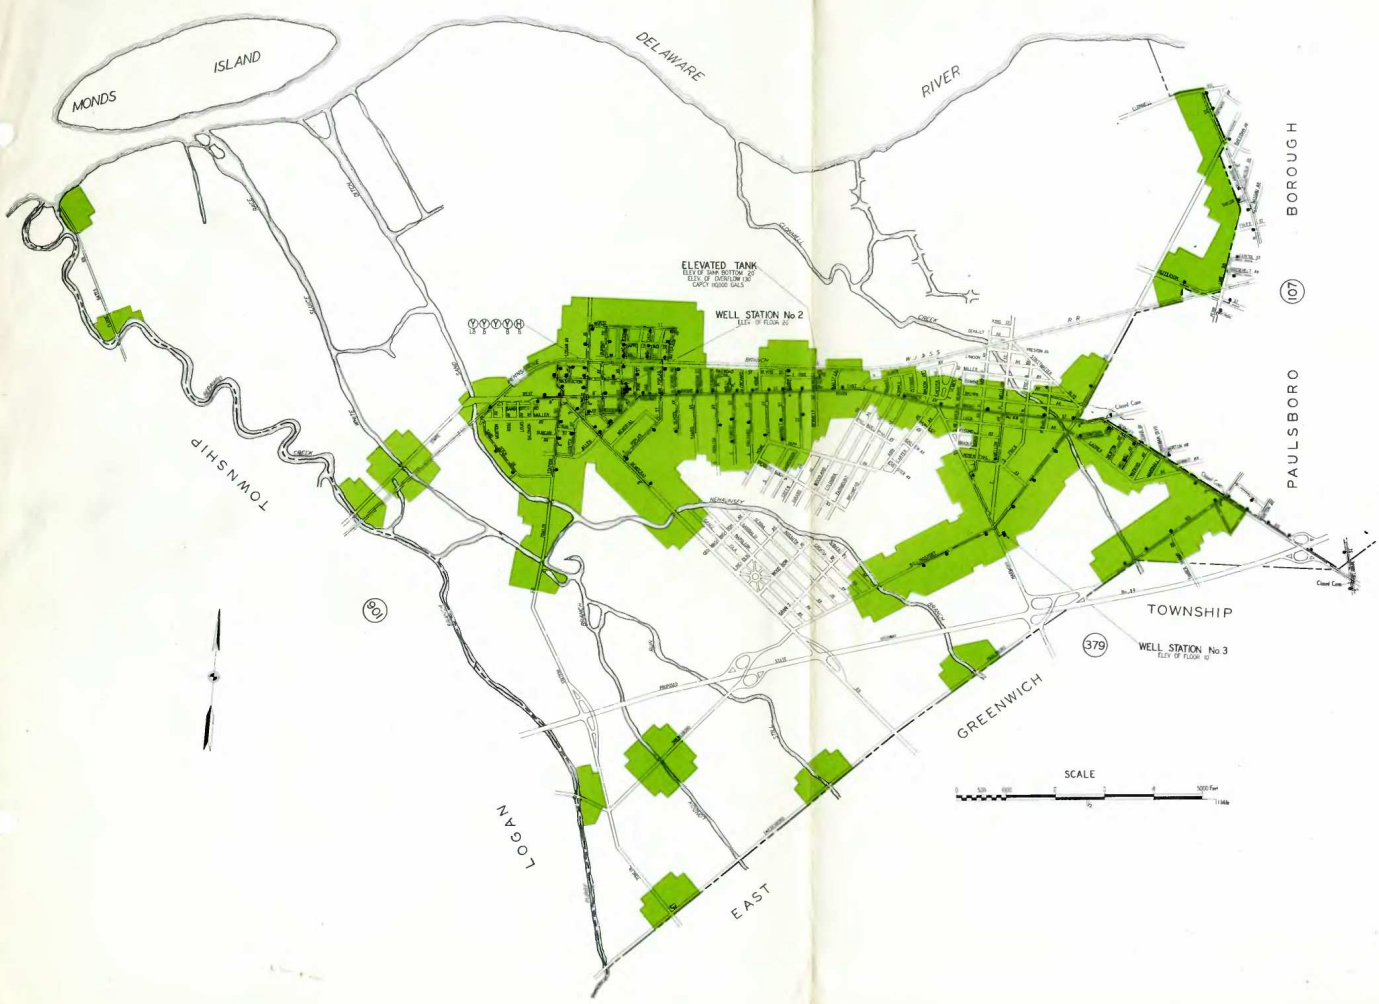

KEY

PROTECTED FIRE ZONE: Shaded in Green

Water mains 8 inches and larger in diameter

Water mains 6 inches and longer in diameter

Water mains 4 inches in diameter

Fire hydrants shown thus

Gate valves shown thus

Fire alarm shown thus

Fire apparatus designated by symbols thus:

① Pumping engine and hose car

② Fire car

③ Booster tank or tank on above

④ Ladders on above

THE FIRE INSURANCE RATING ORGANIZATION OF N. J. ENGINEERING DEPARTMENT NEWARK 2, N. J.

Greenwich Township
Including Gibbstown
Gloucester County, New Jersey

JANUARY 15, 1963